



JOHN BEL EDWARDS
GOVERNOR

State of Louisiana
DEPARTMENT OF WILDLIFE AND FISHERIES

CHARLIE MELANCON
SECRETARY

Louisiana Natural & Scenic River System
SCENIC RIVER PERMIT #965

Issue/Effective Date: July 14, 2016

Scenic River: Tickfaw River

Recipient: Water Works District No. 2 of St. Helena Parish
c/o Professional Engineering Consultants Corp.
Attn: Kevin Gravois
7600 Innovation Park Drive
Baton Rouge, LA 70820

Description: Proposed Directional Drill of a 6" Water Main

This permit is issued under the authority of Part II of Chapter 8, Title 56 of the LRS of 1950 as amended and re-enacted regarding the Louisiana Natural & Scenic Rivers System and the administrative procedures pertaining to the management of watercourses designated as Scenic Rivers.

The permit is issued by the Administrator with the understanding that the permit holder, in implementation of the project, will proceed in compliance with the general and special conditions contained herein. The permit holder is expected to minimize adverse impacts to the structural and functional integrity of the natural systems and aesthetics associated with the Scenic River where the activity is occurring so as to preserve the fundamental character and purpose for which the System was established.

The Administrator assumes no responsibility and incurs no liability for injury or damage to persons or property caused by any act or omission of the permit holder or his agent in the permission granted by this permit. In addition to the Department of Wildlife & Fisheries, the application was given a full and thorough evaluation by the Louisiana Departments of Agriculture & Forestry; Culture, Recreation & Tourism; Environmental Quality; and the Office of State Planning and Budget. If during the review process objections were made to the proposed activity, those objections were either found to be insignificant or they have been included in the conditions of the permit.

This permit shall expire if the permitted activity has not begun within 18 months of the "Effective Date" indicated above.

The Permittee shall adhere to and comply with the following permit conditions:

General Conditions:

- 1) Adequate erosion/sediment control measures are to be taken during the implementation of this project to insure that no sediments or other construction/activity related debris are allowed to enter the Tickfaw River.
- 2) Permittee will acquire all other federal, state, local, and municipal permits and permissions required for the permitted activity prior to commencement of work. Permittee has title to the property or permission from the landowner to implement the project.
- 3) If during project activity, any sensitive archaeological, biological or botanical element is encountered, activity will temporarily cease and the permit holder will contact the Administrator to determine the disposition of that element or artifact.
- 4) This project must be carried out in a manner consistent with the design that the applicant submitted during the permit process and as depicted in the attached "final plats". Should significant physical modification to the project become necessary during implementation of the project or after its completion, the permit holder will submit a letter of explanation within one week of discovery to the Administrator to determine if another permit application will be required.
- 5) Any authorization issued under the authority of this permit may not be transferred to another party without giving prior notice to the Scenic Rivers Program Coordinator.
- 6) The permittee shall allow representatives of LDWF to make periodic inspections to ensure the activity is in accordance with the conditions of this permit.

Special Conditions:

- 1) Upon completion of the activities authorized by this permit, the permittee shall immediately contact this Department (*Chris Davis at (225)765-2642 or Matt Weigel at (985)543-4777*) and submit post-construction, photographic documentation of the proposed project to LDWF within 30 days following project completion. LDWF will review the completed activity to assure that all activities were performed in accordance with the conditions of this permit.
- 2) The permittee shall post a copy of this Scenic Rivers Permit in a conspicuous location at the site of the activity authorized by this permit during all phases of construction.

- 3) The permittee shall ensure that all contractors, subcontractors, and workers are made fully aware of the limits of the work authorized by this permit and adhere to and comply with all conditions listed in this Scenic River permit. Non-compliance with permit terms and conditions may result in permit suspension or revocation, and all other remedies allowed by law.
- 4) The proposed water main installed under the authorization and conditions of this permit shall be removed from the site when it becomes abandoned or is no longer in service. Should the proposed water main become exposed within the Tickfaw River, the permittee shall contact the Scenic Rivers Program to devise a plan to either remove or rebury the water main. This condition does not preclude the necessity for revising the current permit or obtaining a separate Scenic Rivers Permit, should one be required, for such removal or reburial activities.

If you need additional information, please contact Mr. Chris Davis, Scenic Rivers Coordinator, in the Baton Rouge Office at (225) 765-2642.



Charrie Melancon
Administrator

OWNER: ST. HELENA PARISH POLICE JURY

USER AGENCY: WATER WORKS DISTRICT

NO. 2 OF ST. HELENA PARISH

CWEF WATER DISTRIBUTION SYSTEM ADDITIONS


PEC PROJECT NO. 11230
 APRIL 2016

BOARD MEMBERS

JIM HITCHENS	PRESIDENT
WILBERT KNOX	VICE PRESIDENT
EVELYN JONES	SECRETARY - TREASURER
TERRY ADDISON	
LEA VERN SIMS	
JOHN YENT	MANAGER
PEVEY LEE	CONSULTANT

INDEX OF SHEETS

SHEET NO.	DESCRIPTION
1	TITLE SHEET
2	INDEX MAP
3	WATER DISTRIBUTION PLANS
4	TUCKAW RIVER AND RELIEF RIVERS (2) CROSS SECTION
5	MISCELLANEOUS WATER DETAILS
6-7	TEMPORARY EROSION CONTROL DETAILS (OOTD STANDARD PLAN)

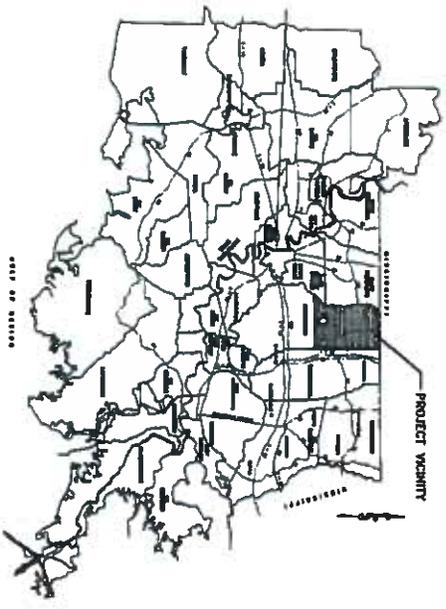

VICINITY MAP



Don A. Davies
 License No. 27722



PROFESSIONAL ENGINEERING
 SERVICES, INC.
 1100 PINE BLVD., SUITE 100
 MONROE, LA 70132

Final Plan
 2-14-16

60% FINAL PLANS

07-OCT-2010 10:44

NO.	DATE	BY	CHKD.	DESCRIPTION
1				
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				
26				
27				
28				
29				
30				
31				
32				
33				
34				
35				
36				
37				
38				
39				
40				
41				
42				
43				
44				
45				
46				
47				
48				
49				
50				
51				
52				
53				
54				
55				
56				
57				
58				
59				
60				
61				
62				
63				
64				
65				
66				
67				
68				
69				
70				
71				
72				
73				
74				
75				
76				
77				
78				
79				
80				
81				
82				
83				
84				
85				
86				
87				
88				
89				
90				
91				
92				
93				
94				
95				
96				
97				
98				
99				
100				


WATER WORKS DISTRICT NO. 2
OF ST. HELENA

LA HWY 30 AT TOOFAN RIVER WATER MAIN RELOCATION
NEW WATER MAIN PLAN - South

NO.	DATE	BY	CHKD.	DESCRIPTION
1				
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				
26				
27				
28				
29				
30				
31				
32				
33				
34				
35				
36				
37				
38				
39				
40				
41				
42				
43				
44				
45				
46				
47				
48				
49				
50				
51				
52				
53				
54				
55				
56				
57				
58				
59				
60				
61				
62				
63				
64				
65				
66				
67				
68				
69				
70				
71				
72				
73				
74				
75				
76				
77				
78				
79				
80				
81				
82				
83				
84				
85				
86				
87				
88				
89				
90				
91				
92				
93				
94				
95				
96				
97				
98				
99				
100				

LA HWY 30 AT TOOFAN RIVER WATER MAIN RELOCATION
NEW WATER MAIN PLAN - South

10/20/16

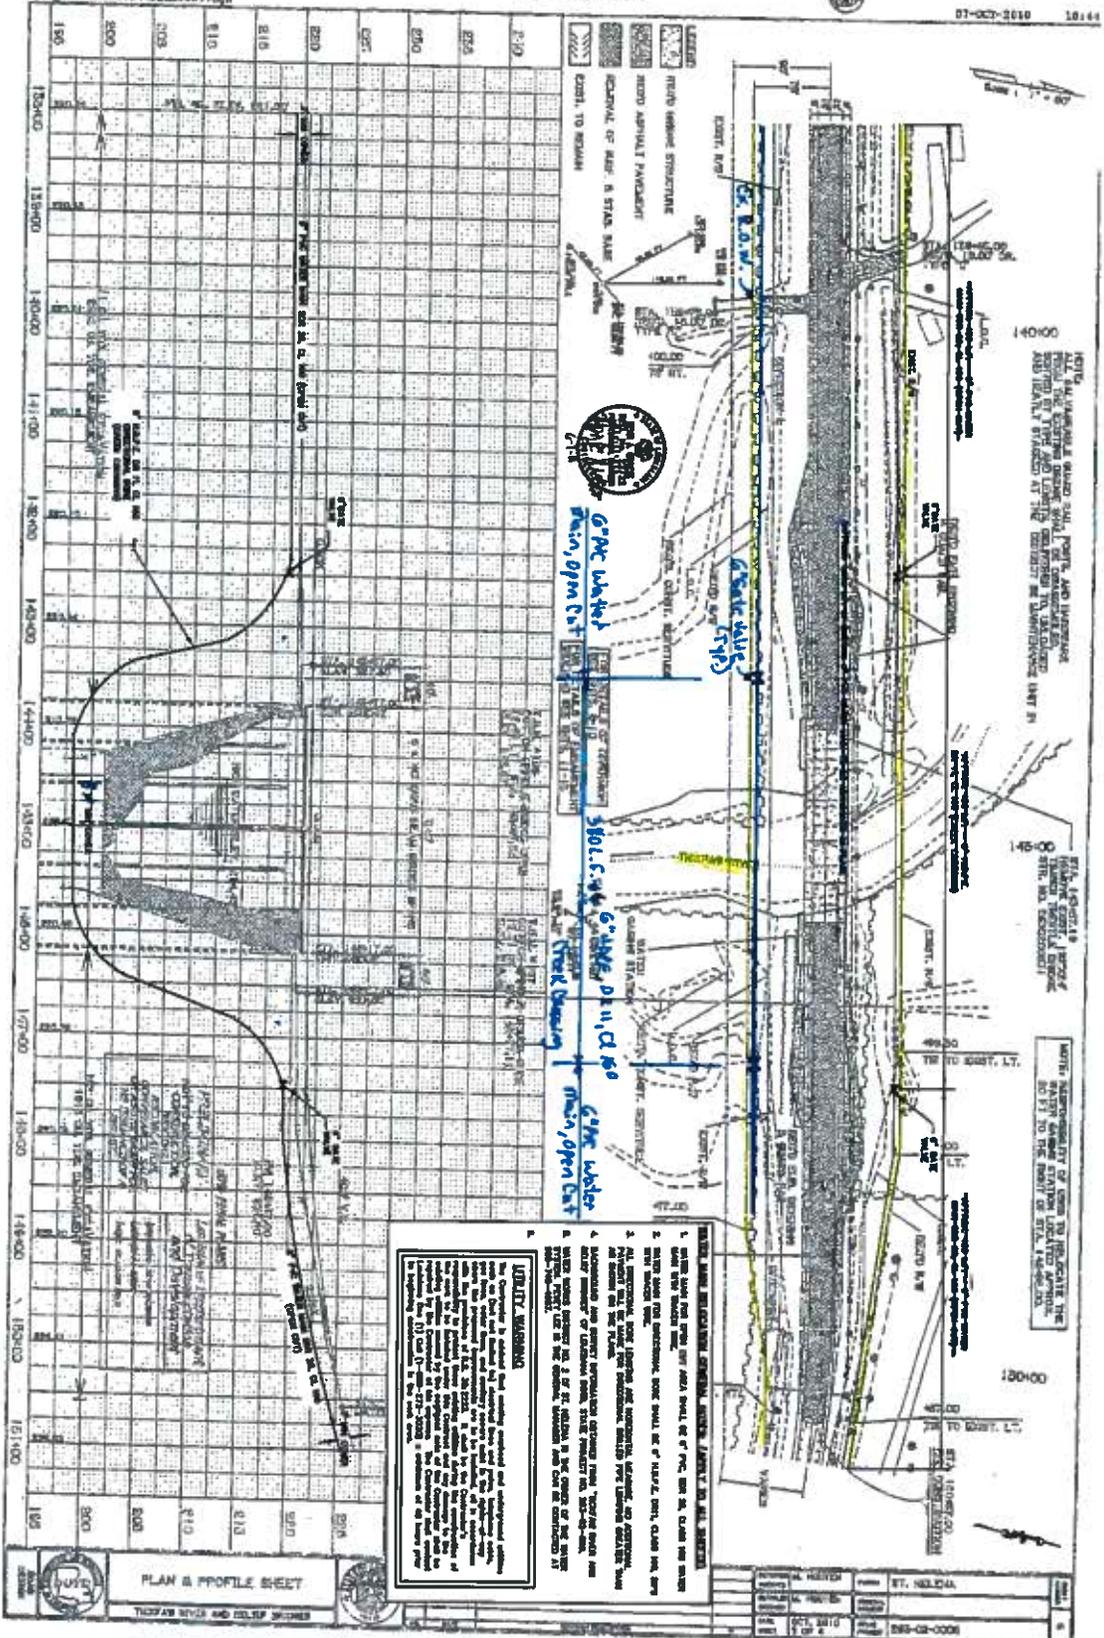

WATER MAIN RELOCATION GENERAL NOTES:

1. WATER MAIN SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.
2. WATER MAIN SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.
3. ALL CONNECTIONS SHALL BE MADE BY WELDING OR GALVANIZED STEEL.
4. MANHOLES SHALL BE 24" DIA. 60 PSI CLASS 200 PIPE.
5. VALVES SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.
6. WATER MAIN SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.
7. WATER MAIN SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.
8. WATER MAIN SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.
9. WATER MAIN SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.
10. WATER MAIN SHALL BE 6" DIA. 60 PSI CLASS 200 PIPE.

UTILITY MARKING

The Contractor is advised that existing underground utilities are shown on this plan. It is the responsibility of the Contractor to locate and mark all existing utilities prior to construction. The Contractor shall be responsible for any damage to existing utilities. The Contractor shall be responsible for any damage to existing utilities.

2-14-16
FINAL PAST